

Menutree Website:


- + Products / docu / downloads
- + Accessories
 - + Antennas / Accessories
 - + Magnetic base antenna

QR-Code Website:



Please make sure to update your drivers before using our products.

Connecting S7-PLCs without head-station

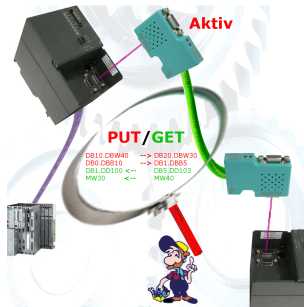


Direct data-exchange between S7-PLCs with S7-LAN.

Thanks to active PUT/GET directly in the module without superordinate head control!

Transfer data directly from one MPI/Profibus-PLC to another.

Bus independent! MPI-bus Profibus / Profibus Profibus / MPI-bus MPI-bus

Setting the PLC time

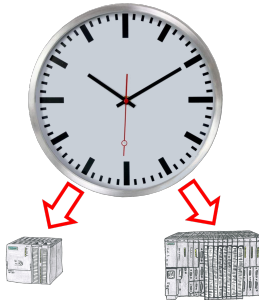


Summer-/winter-time switching, yet this buzzword is one term. Always in March and October the problem of time-change to the PLCs of their plant(s). Capture the controllers in the "S7-PLC exact time synchronization"-tool and automates setting the time in the controllers.

No change on the PLC-program necessary!

Whether MPI/Profibus via S7-LAN or Profinet!

BOSCH-CL <=> S7-TCPIP

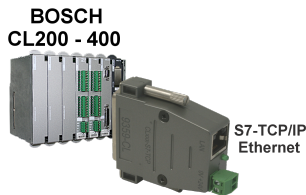


Bring your BOSCH-CL control CL200 - CL400 into the network

Link the PLC with your production-data-acquisition or other Industry 4.0-applications

Communicate with the controller as if you were talking to an S7-PLC, but the data comes from the CL-PLC


Networking CL-controllers without much effort (set the IP-address to match your subnet in the module, nothing more)

Data backup S5-PLC on USB-stick



S5-PLC triggered DB-backup/-restore without additional PC via PG-socket and Ethernet on USB-stick


Independent operation through power-pack-supply

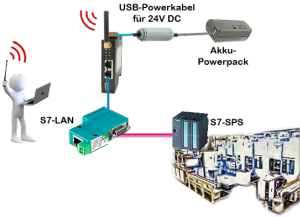

You want for e.g. moving around your system/control and need a 24V-DC-supply for your access-point ALF-UA?

With USB-power-cable and a USB-power-bank/-accu, the problem can be solved immediately with little effort.

Sinec-L1-bus without master (CP530)

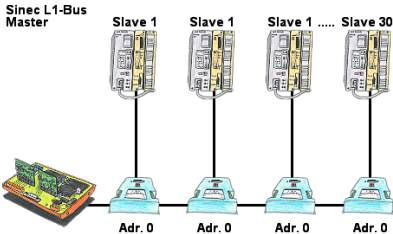

You have a running Sinec-L1-bus and your master the CP530 is defective or rather broke down and the bus has to continue running? No problem, connect the L1-controller to the according bus-modules instead of the CP530, define the circulation list of the clients and the L1-bus continues running immediately.

Variable-chart without Step7-programming package
--



You would like to give your customer the opportunity to read current numbers of the manufacturing Online, without installing a visualisation or even the STEP7-package? Then a S7-LAN with the option Status Variable" is needed, and your customer can take a look at these password protected data on a site of the integrated webserver.