

Menutree Website:

- + Products / docu / downloads
- + Accessories
 - + Connection cable / adapter
 - + RS232
 - + Serial cable 9-pin

QR-Code Website:




Please make sure to update your drivers before using our products.

Remote-maintenance Siemens-S7-PLC with MPI/Profibus



Remote-maintenance of a Siemens-S7-controller with S7-LAN on MPI/Profibus via secure VPN-tunnel of the TeleRouter

Active on every S5-PLC

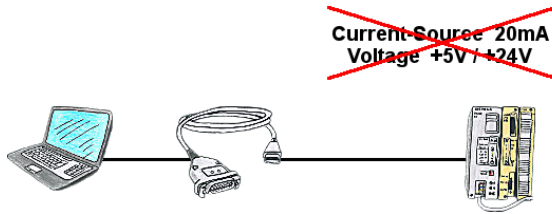


PLC's without current-sources (+20mA) and voltages (5V/24V) at the PG-interface such as the AS511-plug-in card?

The PG-USB-cable does not need anything, it is supplied directly from the USB-socket to which it was plugged. It is active towards its communication-partners, contains its own current-sources.


Universally connected to the S5-PLC without worrying about the supply. Function also given on controls with current-sources/voltages.

Protection for data-dump and modification

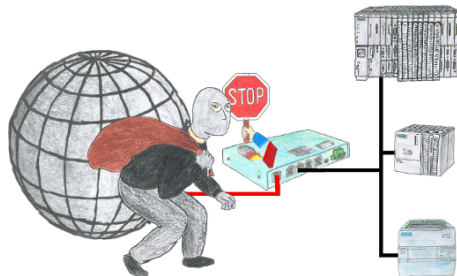


You want to protect your system against unauthorized access and changes? No problem, with the S7-firewall you secure your system against unauthorized access and thus prevent deduction or alteration of your system and process data.

Standardised time

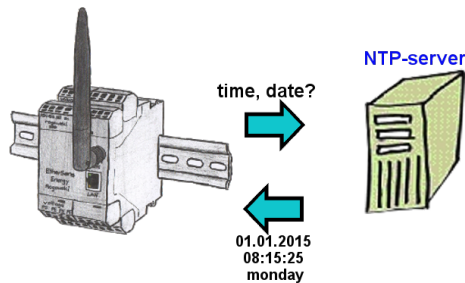

Should all EtherSens devices record time-synchronized in your equipment? By coupling with an NTP-time-server, all devices pick up the current time and adjust this.

Coupling of S5-PLC with S7-PLC via PD-interfaces

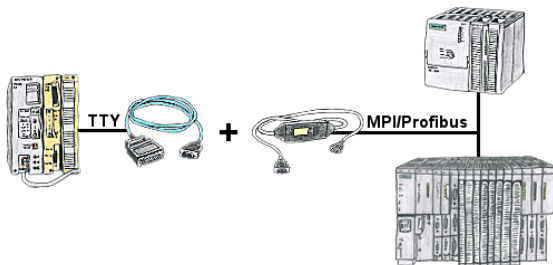


S5 in the machine-park, conversion to S7 not profitable, central-control still requires production-data, who does not know this problem.

With "S5anMPI" you connect the S5-PLC with a standard interface-cable with the MPI/PROFIBUS of a S7-PLC. Loading handling-blocks in both PLCs, communication integrated and "S5anMPI" exchanges DB-content on request of the respective PLC. Configuration in the "S5anMPI" which PLC is active, also both PLCs active is possible.


Data-exchange without much effort and the S5-PLC continues in the S7-combination as usual and does not have to be replaced.

Data logger with FTP-interface

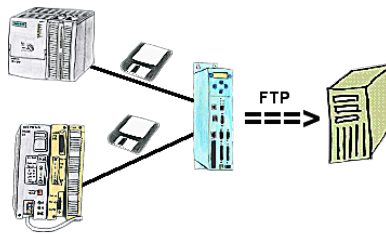

You need a data logger which tape-records the specified data of the PLC and you can collect the data via FTP on demand. No problem, TP-II with the option Datalogger is the solution for you.

WinTELEPROF-software = software-PG-TELE

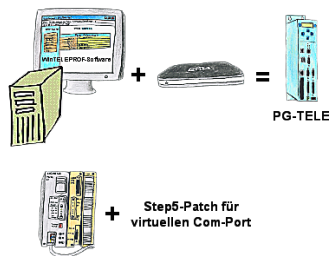

You're using the devices of the Tele-Network-family and don't want to have a device standing on the table? No problem. Install the WinTELEPROF-software on your PC and after link connection access to your Step5/7-programming software (also Siemens) via a virtual Com-Port.

At Step5 the Step5-software is going to be patched, then working with the virtual Com-Port will be also possible.