

Menutree Website:


- + Products / docu / downloads
- + Hardware
 - + Time
 - + PLC-clock

QR-Code Website:



Please make sure to update your drivers before using our products.

Profinet life cycle monitoring and alarming

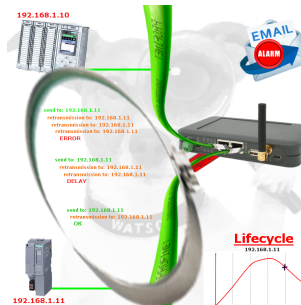

Identify impending failures in your Profinet.
Creeping aging will be displayed to you very detailed.
The Profinet-Watchdog give you the change to react before something happens.


Display diagnostic-buffer without Simatic-Manager



Via the connection-menu and the included bus-device-display, it is possible to display the diagnostics buffer of the respective device without having to open Simatic-Manager or TIA-Portal separately.

The data received from the module is output directly in one piece without the hassle of changing tabs. All data at a glance.


Informations about the bus

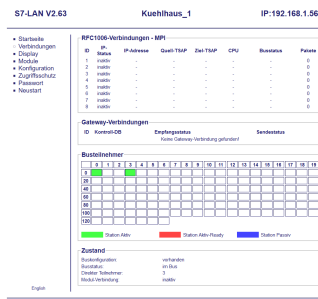

View information from the connected bus-system in plain text without using the Simatic-Manager or TIA-Portal. With the connection-menu you get the list of reachable nodes, marked in color whether it is an "active bus-participant", is a "candidate for inclusion in the bus" or a "passive bus-participant".


You can also see whether cyclic bus-parameter-protocols have been received, you are "in the bus" yourself, the bus-address of the participant recognized as a "direct participant" (on which the S7-LAN is located) and whether the contained modules such as "variable control", "gateway-coupling",... actively communicate.

Remote maintenance / telecontrol of PLC-devices

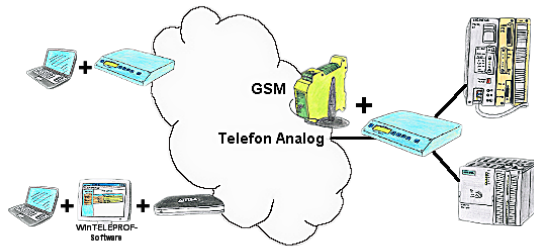


Access to the connected PLC takes place by coupling via Analogue-, ISDN- (only with AB-adapter) and GSM-(only with external GSM-modem)-line.

PLC coupling (data exchange between PLCs)

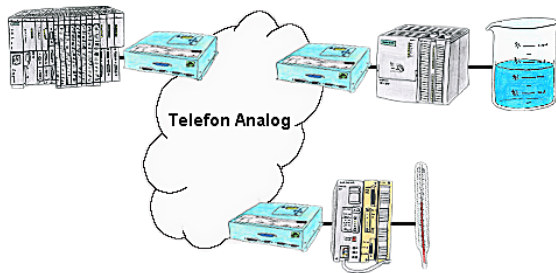


Your pumping stations report the water levels of the central control via telephone network. The central office itself can of course transmit commands/messages to the substations as well. Thereto no dedicated line is required, a "normal" telephone connection is sufficient because the devices hangs up the line after occured message.

Data backup S7-PLC over MPI/Profibus on FTP-server



S7-PLC triggered DB-backup/-restore without additional PC via MPI/Profibus on FTP-server

Data backup S5-PLC on SD-card



S5-PLC triggered DB-backup/-restore without additional PC via PG-socket and Ethernet on SD-card