

Menutree Website:


- + Products / docu / downloads
- + Accessories
 - + Connector plug / equipment
 - + MPI-netadapter with power-adapter

QR-Code Website:




Please make sure to update your drivers before using our products.

Backup of formulas without knowledge of PLC



You consistently have to back up formulas which are stored in data blocks or back up production protocols, but the employee in charge has no knowledge of PLC-programming respectively handling PC-programs? No problem, install the PG-2000-software with "option DB-backup" on your PC and connect it with the PLC. The employee only has to click on a symbol on the desktop of the PC and the data blocks of the parameterised PLC will be stored on the fixed disc. Afterwards the program closes itself and the mentioned employee didn't had to accomplish an intervention on the program.

Simple and uncomplicated remote maintenance

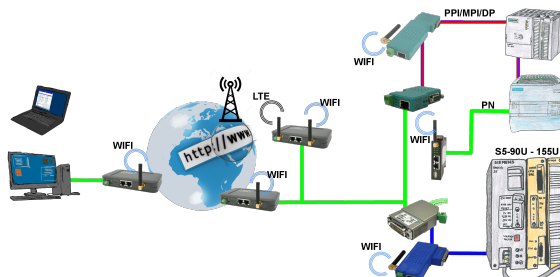


Simple and uncomplicated remote-access to your devices/systems via the Internet

VPN-tunnel, registration at any portal is not necessary, activate the device and select and communicate with the opposite system

No great effort to implement access. Use of the devices without consulting IT, no time-consuming commissioning procedure

All your devices in your own cloud, no access from third-party CONNECT-devices to your devices/systems

Connect MPI / Profibus with current network panels

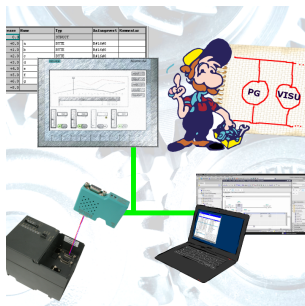


Visualize with the latest S7 network panels directly on your MPI Profibus.

No PLC change necessary.

Connect several nodes at the same time via a network module.


Simultaneous access from different systems possible.

Sinec-L1-bus configuration without BT-777-terminal

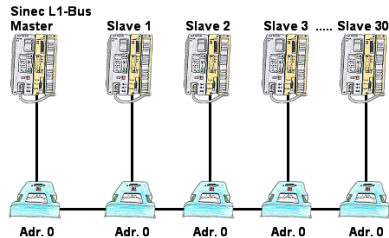


You have to configure a Sinec-L1-bus, own the master, but there's no BT-777-busterminal to buy? No problem, connect the IBX-Klemme to every S5-PLC that is in the run via the optional IBX-SPS-cable, supply every IBX-Klemme with ext. 24V DC if the PLC is not able to provide it, set-up the address 0 and define the actual L1-bus-address in the PLC. Now your master can communicate with the slave-assemblies.

PLC-coupling (data exchange between PLC-devices)

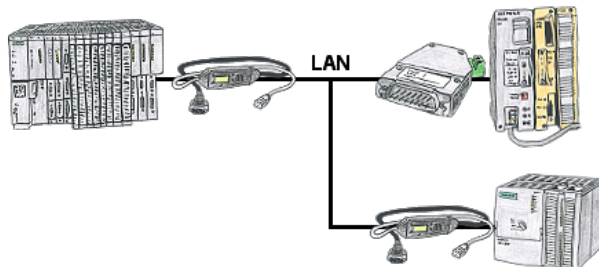


Your pumping stations report the water levels of the central control via telephone network. The central office itself can of course transmit commands/messages to the substations as well. Thereto no dedicated line is required, it's sufficient when the stations connect via network (DSL-router).

Data backup S5-PLC on FTP-server via dig. IO
--



Via digital input triggered DB-backup/-restore without additional PC via PG-socket and Ethernet to FTP-server

Logged data to FTP-server

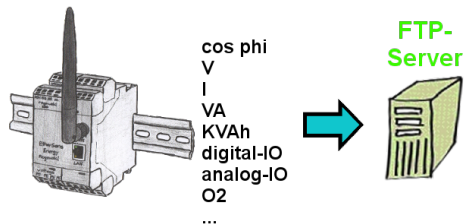

Do you need the logged data not locally but on your site? Then just turn on recording on an FTP-server and the data is stored. You can then immediately read and process this data.