

Technical Documents

PROFIBUS connector

Connect & Detect

V1.2, state: 07/12

General Information

The bus connector connects PROFIBUS user knots or complete PROFIBUS net components to the PROFIBUS line.

Each connector has switchable terminating resistors. Dependent of the type of connector, a PD/diagnosis socket as well as a controller with 4 LED indicators are additionally integrated.

Each connector is identified by a label with its hardware-release and included firmware-version:

H/FFF: H:hardware-release FFF: firmware-version → 5/107: release 5, firmware V1.07

Features

- Cable diagnosis functions via LEDs
- Switchable terminating resistors
- Integrated controller for transfer rates up to 12Mbit/s
- Metal casing with lose-protected “single-screw-mounting”
- Fast connection via insulation cutting clamps




Diagnosis via LEDs

Switch ON/OFF	PWR green	TxD green	Term green	ERR yellow	Description
x	●	x	x	x	Power is OK (+5V ±5%)
x	☼	x	x	x	Power is out of +5V ±5%
x	☼	x	x	☼	Short-circuit of bus wire possible
x	x	○	x	x	No bus activity of participant
x	x	☼	x	x	Bus activity of participant
x	x	●	x	x	Bus activity, RTS (pin 4) of RS485 is not connected
OFF	x	x	○	x	Termination is switched off
OFF	x	x	☼	x	Internal terminating resistor faulty
ON	x	x	●	x	Termination is activated
x	x	x	x	○	No errors detected
OFF	x	☼	○	●	Bus is not terminated
OFF	x	○	○	●	Bus is open

on: ● off: ○ blinking (5Hz): ☼ not relevant: x

Switchable terminating resistors




The switchable terminating resistors are activated by a slide switch, easily accessible from both sides right and rear.


Hereby shutoff of the outgoing bus line is possible. Also for testing purposes the following PROFIBUS components connected via "OUT" can be switched off without removing the connector.

Please make sure to terminate the last participants on the bus at both ends and to connect them to the bus cable via "IN".

Stripping the cable (tool example)

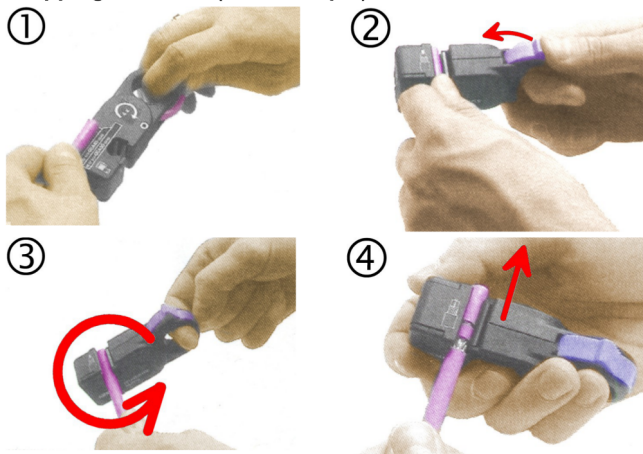


- Measure wire length on template:



- Insert end of cable and push fixing slider as far as it goes
- Rotate stripping tool repeatedly around the cable
- Pull off stripper (in closed state)
- Remove cut-off wire/core insulations remainder


Connecting the PROFIBUS cable

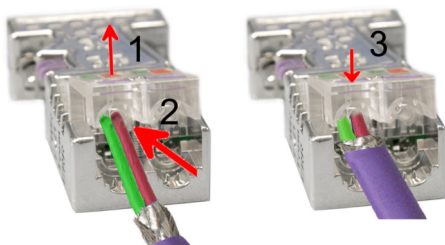

- Loosen the screw
- Lift contact-cover
- Insert both wires into the ducts provided (watch for the correct line color as below!)
- Please take care that you do not cause a short circuit between screen and data lines!
- Close the contact cover
- Tighten screw

Please note: the green line must be connected to A, the red line to B!

Measures in mm:

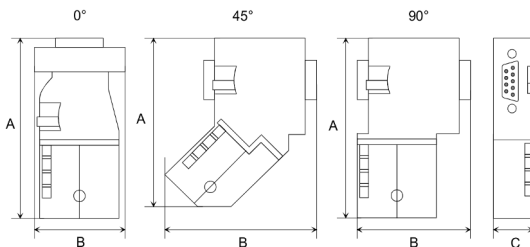

	0°	45°	90°
A	64	61	66
B	34	53	40
C	15.8	15.8	15.8

Technical data	
Power supply by end device	DC 4.75 ... 5.25V
Current	10 ... 30mA
PROFIBUS	SubD-male-9pole
Plugging cycles jack	min. 200
Cable diameter	8 mm
Casing	Zinc-Diecast
Degree of protection	IP20
Temperature range	-20°C ... +75°C
Fixing screws / max. tightening torque	4-40 UNC/ 0.4Nm
Stripping Lengths	
Outside cover/shielding	17mm / 6mm
Connecting technique	Insulation cutting clamps
Bus cable	Type A (EN50170)

Note!

Starting with release 5 also highly flexible bus cable may be used:

Lapp cable order no.: 2170222, 2170822, 2170322.

Menutree Website:


- + Products / docu / downloads
- + Accessories
 - + Connector plug / equipment
 - + Profibus-Plug-DiagConn PB

QR-Code Website:



Please make sure to update your drivers before using our products.

PLC-data in Excel-readable file

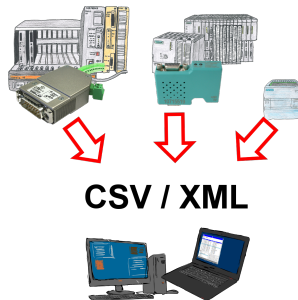


Save your PLC content, production-data in a file on your PC. This file, a CSV- or XML-file (depending on the license), can then be used e.g. further processed with Excel.

A file that includes all configured variables in an infinitely-long list with a suitable time-stamp, either controlled by the PC or via a PLC-trigger (depending on the license). No matter which Siemens-control, as soon as a network-connection is available, nothing stands in the way of recording.


With S7-LAN for PPI, MPI or Profibus or S5-LAN++ for S5-controllers, PLCs without a network-connection can also be addressed and recorded. And depending on the license are several parallel connections possible.

Protection of data areas in the PLC

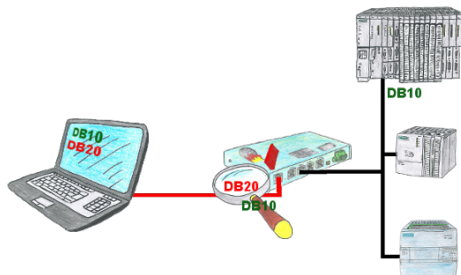

You have in your facility machinery with complex program structures and want to prevent that the users do not change comprehensible content? No problem, with the S7-firewall you can assign specific data fields to each user or even generally protect certain data areas in the PLC.

Remote maintenance with TS-software without original TS-adaptor

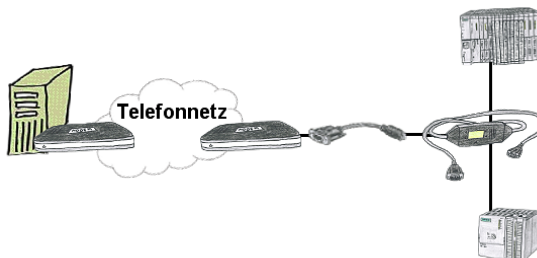

You have to reach urgent your PLC via remote maintenance and have no TS-adaptor in your company? No problem, configure with the MPI-Kabelmanager your S7-interface-cable MPI-II-Kabel the mode "TS" for "remote maintenance", connect this cable with the TS-Adapter (article number 9350-TS) with a standard modem and send it all to your client. Now you will be able to start the connection with your TS-software and solve the problem. And this all without buying a original TS-adaptor.