

**Menutree Website:**


- + Products / docu / downloads
- + Accessories
  - + Connector plug / equipment
  - + Option CheapConn for MPI cables

**QR-Code Website:**



Please make sure to update your drivers before using our products.

Failure report transmission released by the PLC

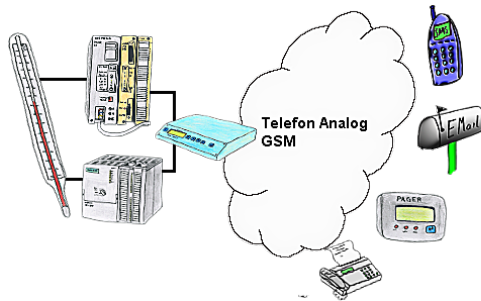


Your outstation reports the current value cyclically, or in case of malfunction the status via FAX, to your mobile phone as SMS or to your pager.

## Wireless around the Moeller-PLC




Move wirelessly around the Moeller-PLC and communicate for example ONLINE in the status

## Data acquisition/logging

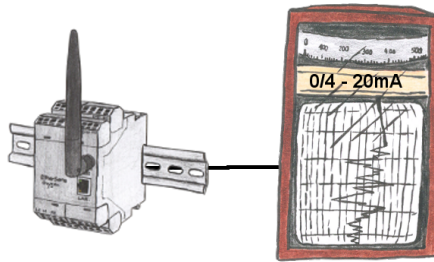


By connecting a line-recorder to the EtherSens-device anyone without network-knowledge can visually capture and further process the log.

## S7-CP-replacement (without LAN-CP to the PLC-device)

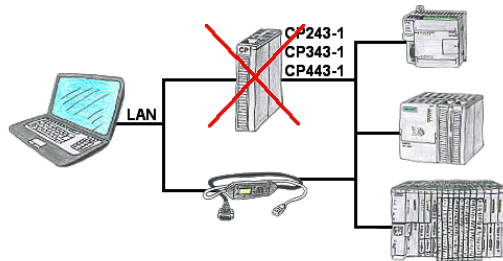

Do you have a S7-PLC-device without CP243-1, CP343-1 or CP443-1 and would like to connect via LAN? Then plug the S7-LAN on the PLC-device and your access via RFC1006 is ready for use.

## EtherSens-cloud

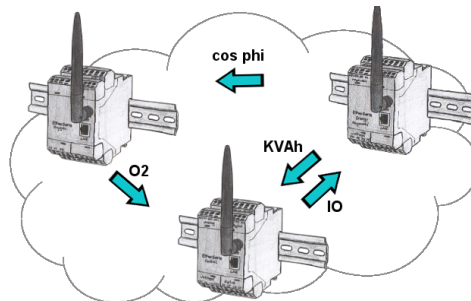


By the EtherSens-cloud each EtherSens-device can exchange data, transfer data and forward to other devices. As if you use one device that records all necessary parameters centrally.

## Remote-maintenance Siemens-S5-PLC with firewall



Remote-maintenance of a Siemens-S5-controller with S5-LAN++ on PD-port via secure VPN-tunnel and scalable firewall

## Separate your machine-net from the office-net

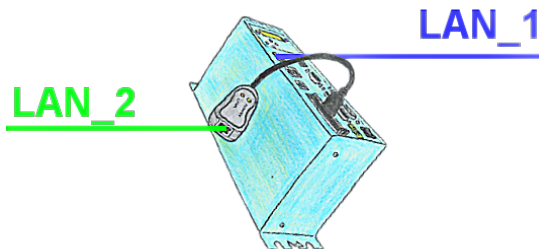

You need a separation between the machine-net and the office-net? No problem, plug a PCMCIA-LAN-card in your Tele-Prof-II-device (only for version -H) and the separation is OK. You have access to both nets via remote maintenance.