

Menutree Website:

- + Products / docu / downloads
- + Accessories
 - + Antennas / Accessories
 - + Sector antenna for ALF

QR-Code Website:




Please make sure to update your drivers before using our products.

Wireless around the Moeller-PLC



Move wirelessly around the Moeller-PLC and communicate for example ONLINE in the status

PLC-data in Excel-readable file

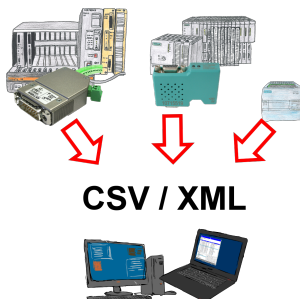


Save your PLC content, production-data in a file on your PC. This file, a CSV- or XML-file (depending on the license), can then be used e.g. further processed with Excel.

A file that includes all configured variables in an infinitely-long list with a suitable time-stamp, either controlled by the PC or via a PLC-trigger (depending on the license). No matter which Siemens-control, as soon as a network-connection is available, nothing stands in the way of recording.


With S7-LAN for PPI, MPI or Profibus or S5-LAN++ for S5-controllers, PLCs without a network-connection can also be addressed and recorded. And depending on the license are several parallel connections possible.

Capture data and control independently

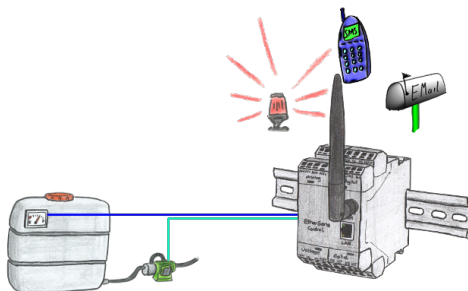


Apply small control tasks of your systems with EtherSens-Control-devices. Determine switching points where the device is running to respond. Depending on the parameterization, an email or SMS notification (depending on the device-configuration) or the device automatically controls via the optional IO-modules (analog / digital / relay).

S7-300/400 (MPI/DP) to S5

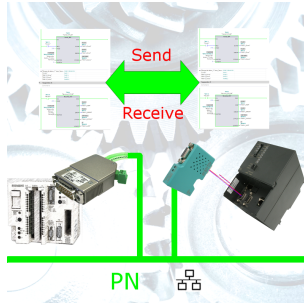

Coupling S7-controller with MPI/Profibus at S5-control with PD-port via network


Communication with PLCs without knowledge of the specific protocol

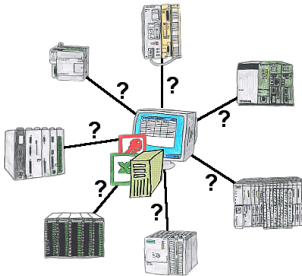

Who does not know the problem for a production-analysis still lack data that is stored in the controller. Without PLC-specific programming-packages you can not get the data and the software-technician has no time.


A one-time change to the evaluation-tool, the PLC-specific DLL-file integrated (also at Excel, Access, ...) and functions for reading and writing data of the controller are available.

Standalone recording

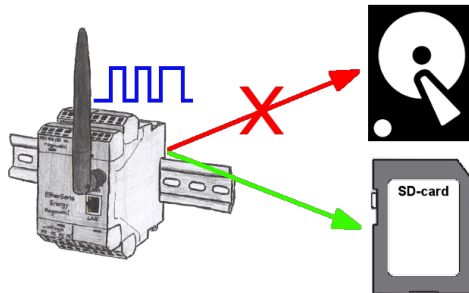

With the integrated SD-card-slot you back-up the recorded data in the device and don't need an external memory. Nevertheless you can send additional the data via FTP to a FTP-server.

Remote maintenance of your S7-PLC-device via LAN / Internet

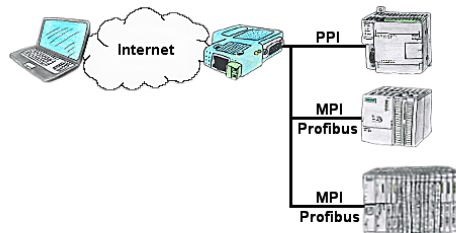

You have access to a on-site network and your PLC-device has no LAN-connection? No problem, plug the S7-LAN on the PLC-device and you will have immediate access to the PLC from afar.