

Menutree Website:


- + Products / docu / downloads
- + Hardware
 - + PD-interface-multiplexer
 - + PG-MUX-II family
 - + PG-MUX-II for Siemens

QR-Code Website:



Please make sure to update your drivers before using our products.

Failure report transmission released by the PLC

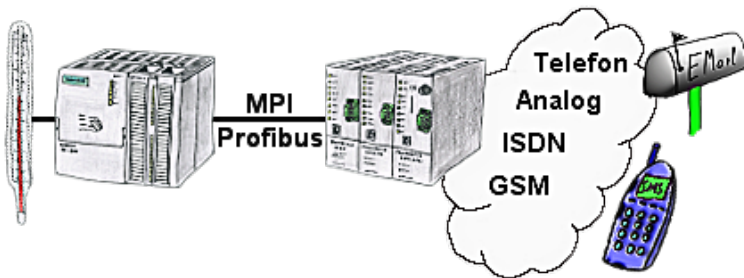


Your outstation reports the current value cyclically, or in case of malfunction the status via FAX, as SMS to your mobile phone, to your pager or also via e-mail.

Remote-maintenance Pilz-PLC




Remote-maintenance of a Pilz-controller with network-connection via secure VPN-tunnel of the TeleRouter

Data logger with FTP-interface

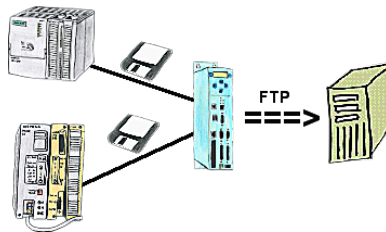


You need a data logger which tape-records the specified data of the PLC and you can collect the data via FTP on demand. No problem, TP-II with the option Datalogger is the solution for you.

Data backup S7-PLC PN-port on USB-stick



S7-PLC triggered DB-backup/-restore without additional PC via PN-port to USB-stick


Communication with PLCs without knowledge of the specific protocol

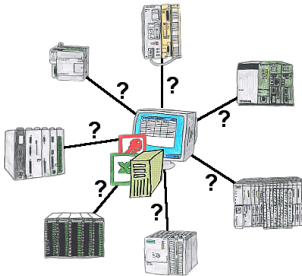

Who does not know the problem for a production-analysis still lack data that is stored in the controller. Without PLC-specific programming-packages you can not get the data and the software-technician has no time.


A one-time change to the evaluation-tool, the PLC-specific DLL-file integrated (also at Excel, Access, ...) and functions for reading and writing data of the controller are available.

Battery buffered time

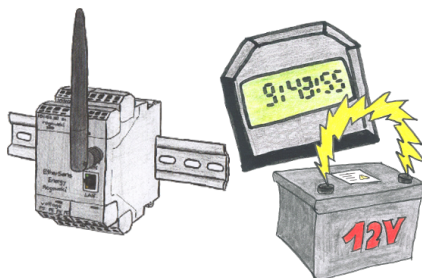

You always need a current time, but do not always have a time-server on site. With the integrated battery-backed RTC you always have the current time in the unit. Even if the power fails, the time in the unit continues to operate, so that when the voltage returns, the time continues to run correctly.

Watching of S5- PLC's with panel for S7-PLC

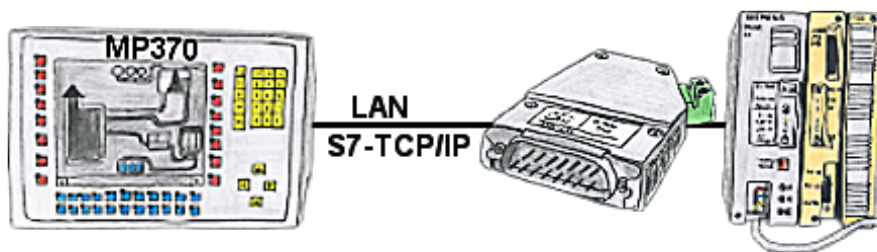

Your panel only has a LAN-socket as PLC-interface and supports only S7-RFC1006, no problem. Connect this socket with the S5-LAN++ and plug it directly on the PD-interface of the PLC. The S5-LAN++ performs adverse your panel as a S7-PLC although you receive the data from the S5-PLC. Then access to the variables and data of the S5-PLC is already available.